
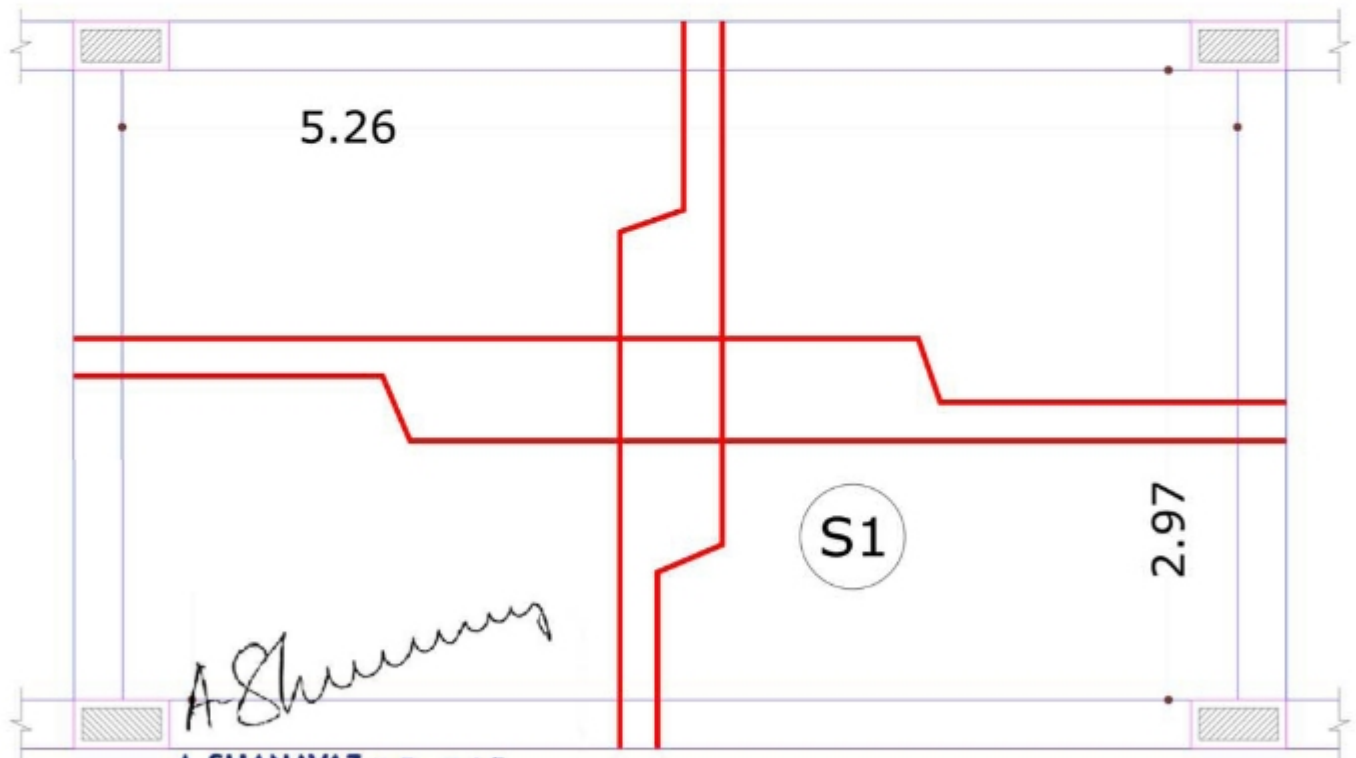
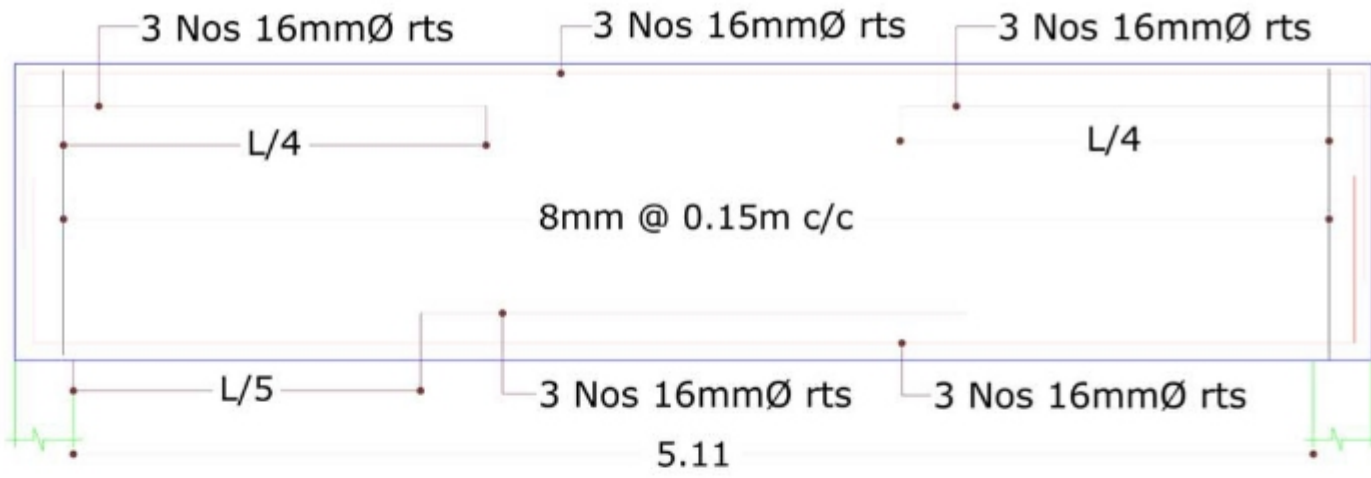


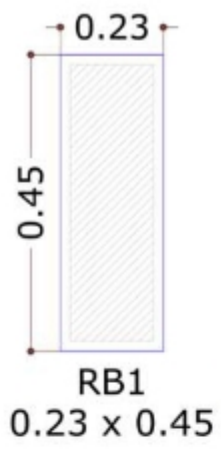

A. SHANAVAZ M.E., M.I.E.,
 Chartered Civil Engg. M-150843-6
 Regd. Struct Engg. Coimbatore DTCP
 SE/GR-1/45/2025

S.NO	REINFORCEMENT IN SHORTER SPAN	REINFORCEMENT IN LONGER SPAN	SL.TK
S1	8mm Ø 0.15m c/c CKD	8mm Ø 0.15m c/c CKD	0.150m

DESIGN OF SLAB

Data:


Concrete	M20	f_{ck}	=	20	N/mm ²
Steel	Fe500	f_y	=	500	N/mm ²
Shorter Span		L_x	=	2.97	m
Longer Span		L_y	=	5.26	m
Assuming Depth of Slab		D	=	150	mm
Assuming Dia of reinf			=	8	mm
Clear Cover			=	20	mm
Eff. Depth of Slab		d	=	126	mm
Eff. Shorter Span		L_x	=	2.97	m
Eff. Longer Span		L_y	=	5.26	m

1. Load Calculations :

Self weight of slab	(0.15 x 20.00)	=	3.00	kN/m ²
Ceiling Plastering		=	0.25	kN/m ²
Floor Finish		=	1.00	kN/m ²
Weathering Course (Weight Not Applicable)		=	0.00	kN/m ²
Live load		=	2.00	kN/m ²
Total Load		=	7.00	kN/m ²
Load Factor		=	1.50	
Factored Load		=	10.50	kN/m ²
Span Ratio		I_y/I_x	=	5.26/2.97
			=	1.77

2. Bending Moment Calculation:

Support Condition	Two Adjacent edges discontinuous continuous)
From IS 456-2000 Table 26	
	$\alpha_{Nx} = 0.086$
	$\alpha_{Px} = 0.065$
	$\alpha_{Ny} = 0.047$
	$\alpha_{Py} = 0.035$
<u>Shorter Span</u>	
Negative Moment (support)	$M_{Nx} = \alpha_{Nx} \times W_u \times L_x^2$ $= 0.086 \times 10.50 \times 2.97^2$ $= 7.97 \text{ kN.m}$
Positive Moment (Mid Span)	$M_{Px} = \alpha_{Px} \times W_u \times L_x^2$ $= 0.065 \times 10.50 \times 2.97^2$ $= 6.02 \text{ kN.m}$
<u>Longer Span:</u>	
Negative Moment (Support)	$M_{Ny} = \alpha_{Ny} \times W_u \times L_y^2$ $= 0.047 \times 10.50 \times 2.97^2$ $= 4.35 \text{ kN.m}$

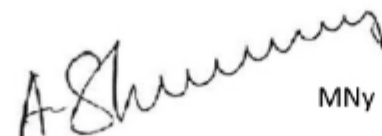

A. SHANAVAZ M.E., M.I.E.,
Chartered Civil Engg. M-150843-6
Regd. Struct Engg. Coimbatore DTCP
SE/GR-I/45/2025

Positive Moment (Mid span)

$$\begin{aligned} M_{py} &= \alpha_{py} \times W_u \times L_x^2 \\ &= 0.035 \times 10.50 \times 2.97^2 \\ &= 3.24 \text{ kN.m} \end{aligned}$$

Reinforcement :

$$\begin{aligned} M_u &= 0.87 \times f_y \times A_{st} \times d \left\{ \frac{1 - (f_y \times A_{st})}{f_{ck} \times b d} \right\} \\ &= 0.87 \times 500 \times A_{st} \times 126 \left\{ 1 - \frac{500 \times A_{st}}{20 \times 1000 \times 126} \right\} \end{aligned}$$

Ast in Shorter Span

Support = 149 mm²

Mid Span = 112 mm²

Ast in Longer Span

Support = 110 mm²

Mid Span = 90 mm²

Shorter Span

Support

Mid Span

Longer Span

Support

Mid Span

Reinf Required

8 ϕ @ 340 mm c/c

8 ϕ @ 320 mm c/c

Reinf Provided

- 8 dia @ 150 mm c/c

- 8 dia @ 150 mm c/c

8 ϕ @ 380 mm c/c

8 ϕ @ 270 mm c/c

- 8 dia @ 150 mm c/c

- 8 dia @ 150 mm c/c

3. Check for deflection

Allowable span / depth Ratio

% of Tension reinforcement

Corresponding Compression reinf.

% of compression reinforcement

l/D = 32

pt = 0.179

Bar dia = 8 mm

spacing = 150 mm

pc = 0.179

Modification factor for Tension reinf.

F1 = 1.20 (From Fig 4 in IS 456 – 2000)

Modification factor for comp.reinf.

F2 = 1.00 (From Fig 5 in IS 456 – 2000)

Modified span/ depth ratio

= l/d x F1 x F2

= 32 x 1.20 x 1.00

= 38.40

Actual span / depth ratio

= 2970 / 126




= 23.57

Actual span / depth ratio < Modified span / depth ratio 23.57 < 38.40

HENCE SAFE & SOUND



A. SHANAVAZ M.E., M.I.E.,
Chartered Civil Engg. M-150843-6
Regd. Struct Engg. Coimbatore DTCP
SE/GR-1/45/2025

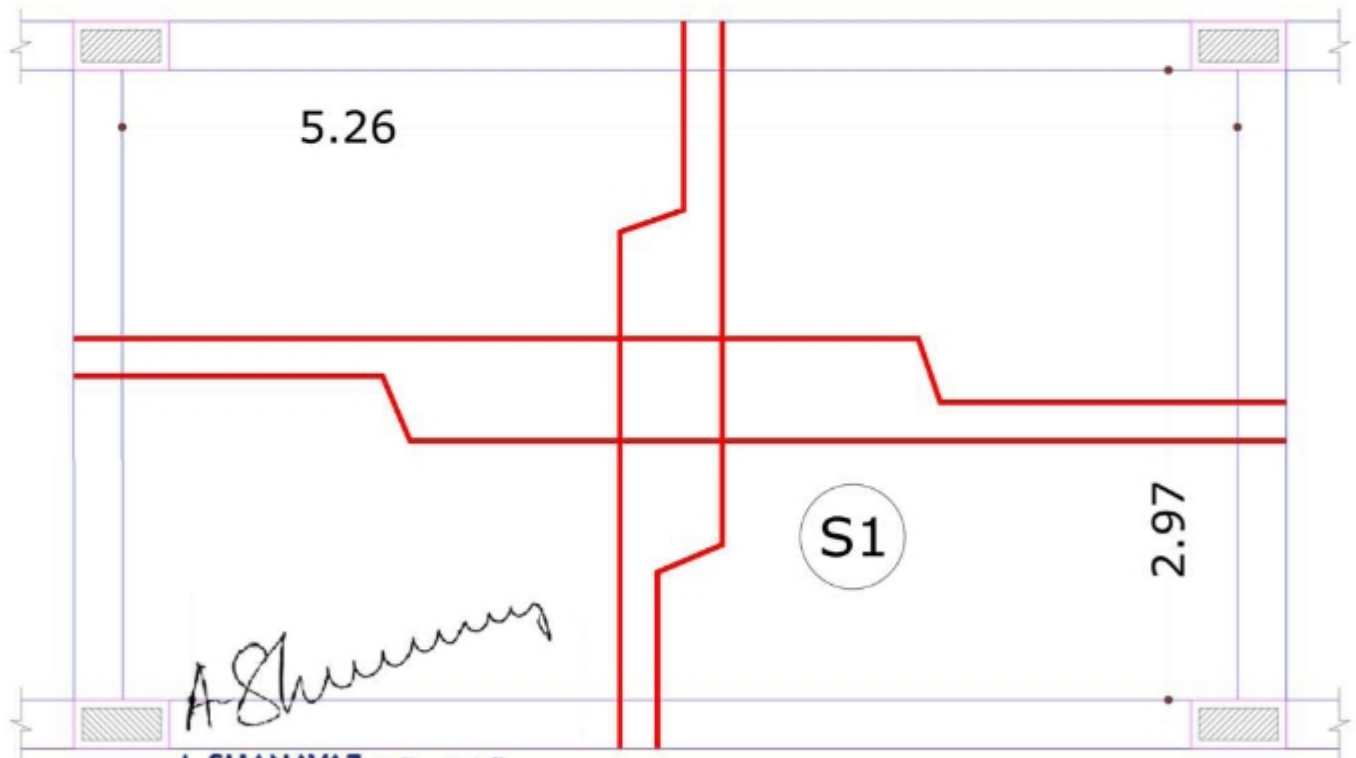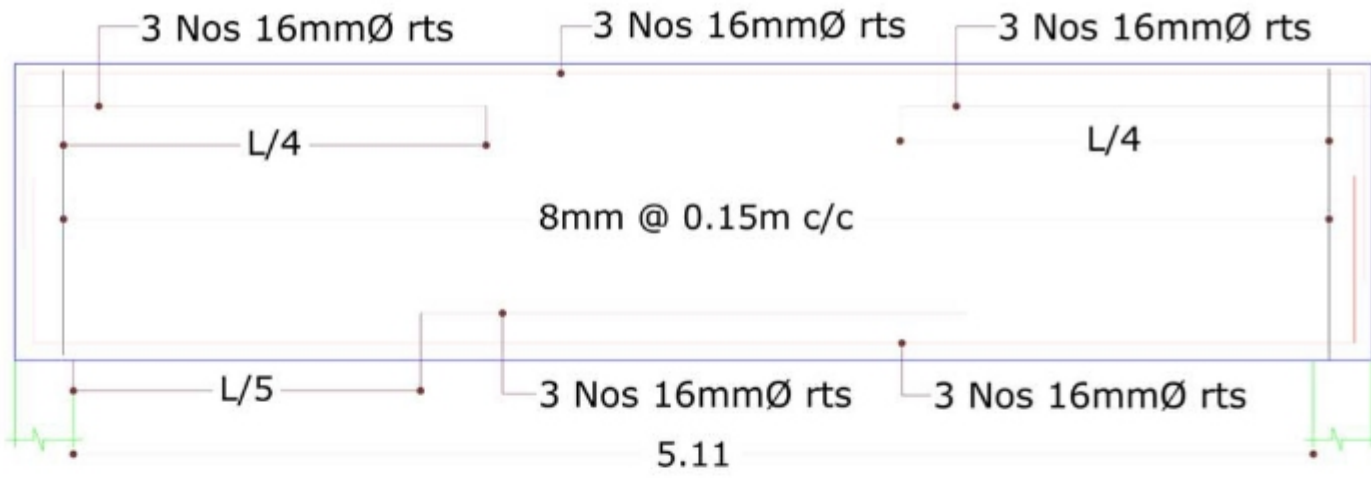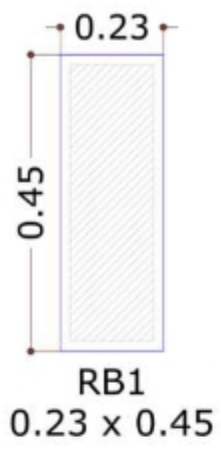

A. SHANAVAZ M.E., M.I.E.,
Chartered Civil Engg. M-150843-6
Regd. Struct Engg. Coimbatore DTCP
SE/GR-I/45/2025

S.NO	REINFORCEMENT IN SHORTER SPAN	REINFORCEMENT IN LONGER SPAN	SL.TK
S1	8mm Ø 0.15m c/c CKD	8mm Ø 0.15m c/c CKD	0.150m

DESIGN OF BEAM

Data:

Effective length	=	5.11 m
	=	5110 mm
Breadth of Beam	=	230 mm
Overall depth (assumed)	=	450 mm
Characteristic strength of steel		
f_y	=	500 N/mm ²
f_{ck}	=	20 N/mm ²
Cover	=	25 mm

Total Load

Dead load from slab	=	3.75 kN/mm ²
Ceiling Plastering	=	0.25 kN/m ²
Floor finish	=	1 kN/mm ²
Total dead load	=	5.00 kN/m ²
Live load	=	2 kN/m ²
Total Load	=	<u>7.00 kN/m²</u>

$$\begin{aligned}\text{Effective Depth} = d &= 450 - 25 - 25 / 2 \\ &= 412.5 \text{ mm}\end{aligned}$$

Distance of centroid of Compression reinforcement from the extreme compression fibre

$$\begin{aligned}d' &= 25 + (25/2) \\ &= 37.5 \text{ mm} \\ \frac{d'}{d} &= \frac{37.5}{412.5} \\ &= 0.09\end{aligned}$$

Minimum Reinforcement

The min.area of tension reinforcement shall not be less than the given,

$$\frac{A_s}{bd} = \frac{0.85}{f_y}$$

Where,

A_s	=	Min.area of tension reinforcement
b	=	Breadth of the beam or breadth of web of T-beam
d	=	Effective depth

$$f_y = \text{Characteristic strength of reinforcement}$$

$$A_s = \frac{0.85 \times b \times d}{f_y}$$


A. SHANAVAZ M.E., M.I.E.,
Chartered Civil Engg. M-150843-6
Regd. Struct Engg. Coimbatore DTCP
SE/GR-I/45/2025

$$= \frac{0.85 \times 230 \times 412.5}{500}$$

$$= 161.29 \text{ mm}^2$$

Referring Design Aids IS:456, The reinforcement as shown in the sketch

$$\text{Overall depth of beam} = \frac{1}{12} \text{ to } \frac{1}{20} \text{ of the span}$$

$$\begin{aligned} \text{Provide over all depth} &= 450 \text{ mm} \\ \text{Width of rib} &= \frac{2}{3} (\text{depth of rib}) = \frac{2}{3} (450 - 150) \\ &= 200 \text{ mm} \end{aligned}$$

Loading on the beam

$$\begin{aligned} \text{From the Slab} &= \frac{Wl_x}{6} \left(3 - \left(\frac{l_x}{l_y} \right)^2 \right) \\ &= \frac{7 \times 3.2}{6} \left(3 - \left(\frac{3.2}{5.11} \right)^2 \right) \\ &= 9.74 \text{ kN/m} \end{aligned}$$

$$\begin{aligned} \text{D.L of the rib} &= 0.23 \times 0.3 \times 25 \text{ kN/m} \\ &= 1.8 \text{ kN/m} \\ \text{Total} &= 11.54 \text{ kN/m} \end{aligned}$$

Providing 16 mm dia bars at clear cover 25 mm


$$\begin{aligned} \text{Effective cover} &= 25 + 8 \\ &= 33 \text{ mm} \\ \text{Effective depth } d &= 417 \text{ mm} \end{aligned}$$

$$\begin{aligned} \text{Center to center bearing} &= 5.11 \text{ m} \\ \text{Effective span} &= 5.11 \text{ m} \\ \text{Max. BM} &= \frac{11.54 \times 3.2 \times 3.2}{8} \\ &= 14.77 \text{ kN.m} \end{aligned}$$

$$\text{Req. depth } d = \left\{ \frac{1.5 \times 14.77 \times 10^6}{2.75 \times 230} \right\}^{1/2}$$

$$\begin{aligned} &= 187.16 \text{ mm} \\ \text{Provided depth, } D &= 450 \text{ mm} \end{aligned}$$

$$\begin{aligned} \frac{M_u}{bd^2} &= \left\{ \frac{1.5 \times 14.77 \times 10^6}{230 \times 417 \times 417} \right\}^{1/2} \\ &= 0.75 \end{aligned}$$

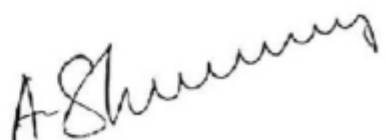
A. SHANAVAZ M.E., M.I.E.,
 Chartered Civil Engg. M-150843-6
 Regd. Struct Engg. Coimbatore DTCP
 SE/GR-1/45/2025

$$p_t = \frac{f_{ck}}{2 \times f_y} \left(1 - \sqrt{1 - \frac{4 \times (M_u/b \times d^2)}{0.87 \times f_{ck}}} \right) \times 100$$

$$= 0.18 \%$$

$$A_{st} = \left\{ \frac{0.18 \times 230 \times 417}{100} \right\}$$

$$= 2884 \text{ mm}^2$$

Provided 6 – Y16

Check for Shear

$$V = \frac{1.5 \times 11.54 \times 5.11}{2}$$

$$= 44.22 \text{ kN}$$


$$T_c = 0.54 \text{ N/mm}^2$$

$$V_{uc} = \frac{0.48 \times 230 \times 417}{1000}$$


$$= 46.1 \text{ kN}$$

$$V_{uc} > \text{Shear at support}$$



Provide Y8 @ 150 c / c (stirrups)

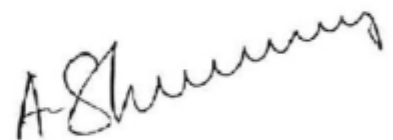

A. SHANAVAZ M.E., M.I.E.,
Chartered Civil Engg. M-150843-6
Regd. Struct Engg. Coimbatore DTCP
SE/GR-1/45/2025

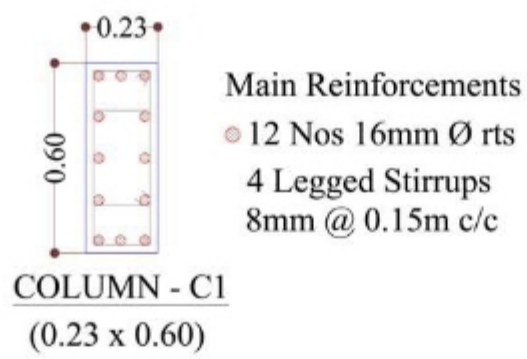

4 Legged Stirrups
8mm @ 0.15m c/c

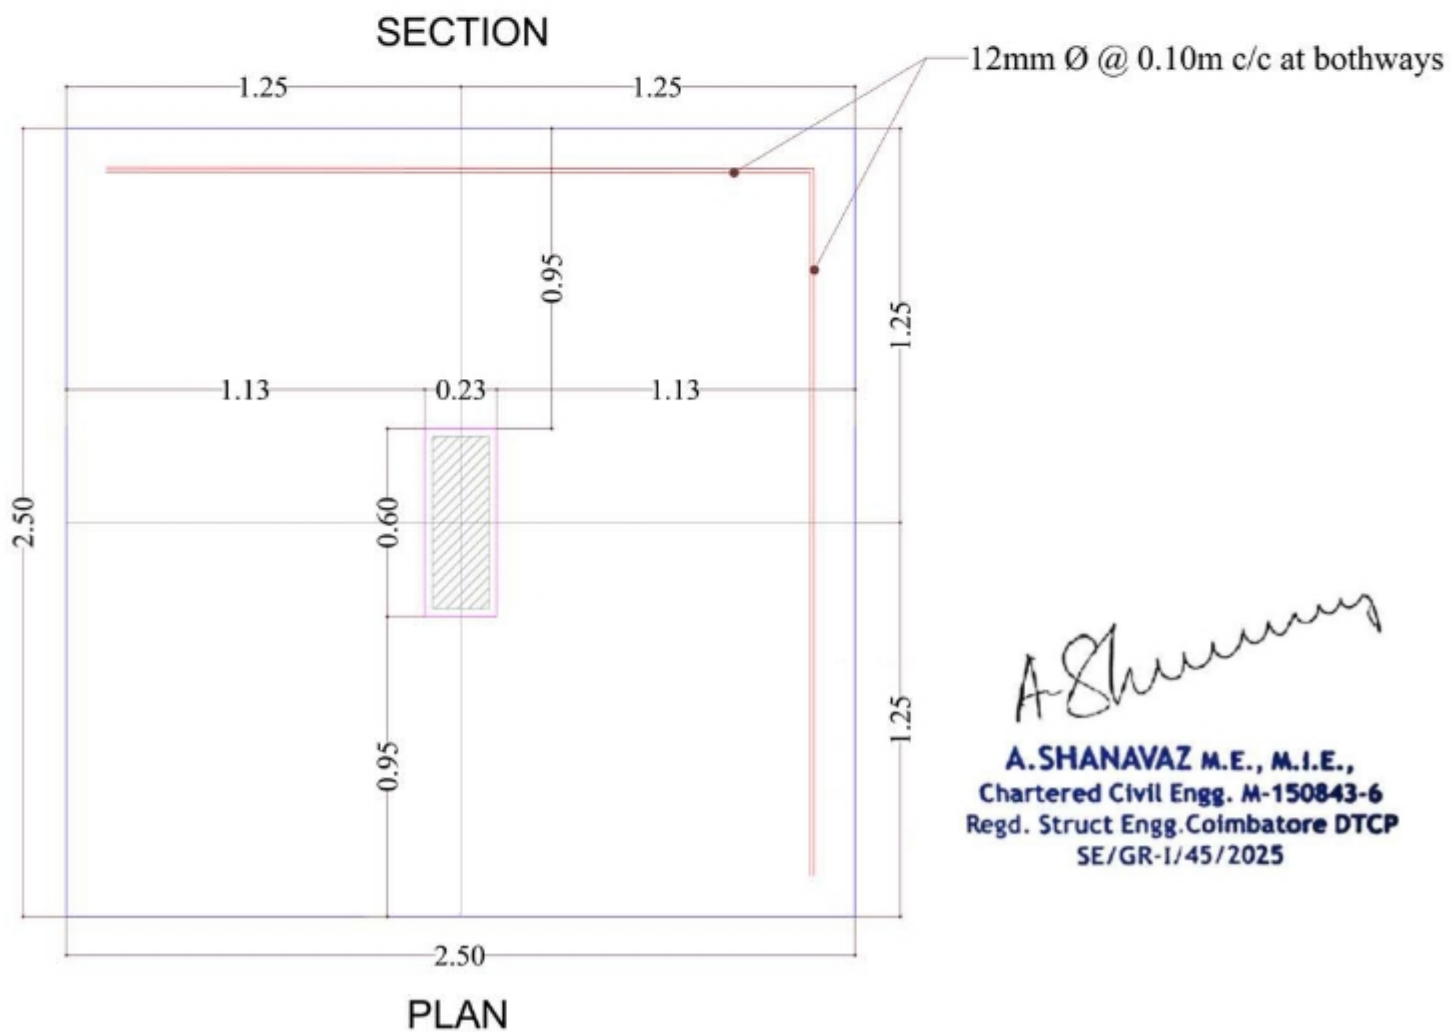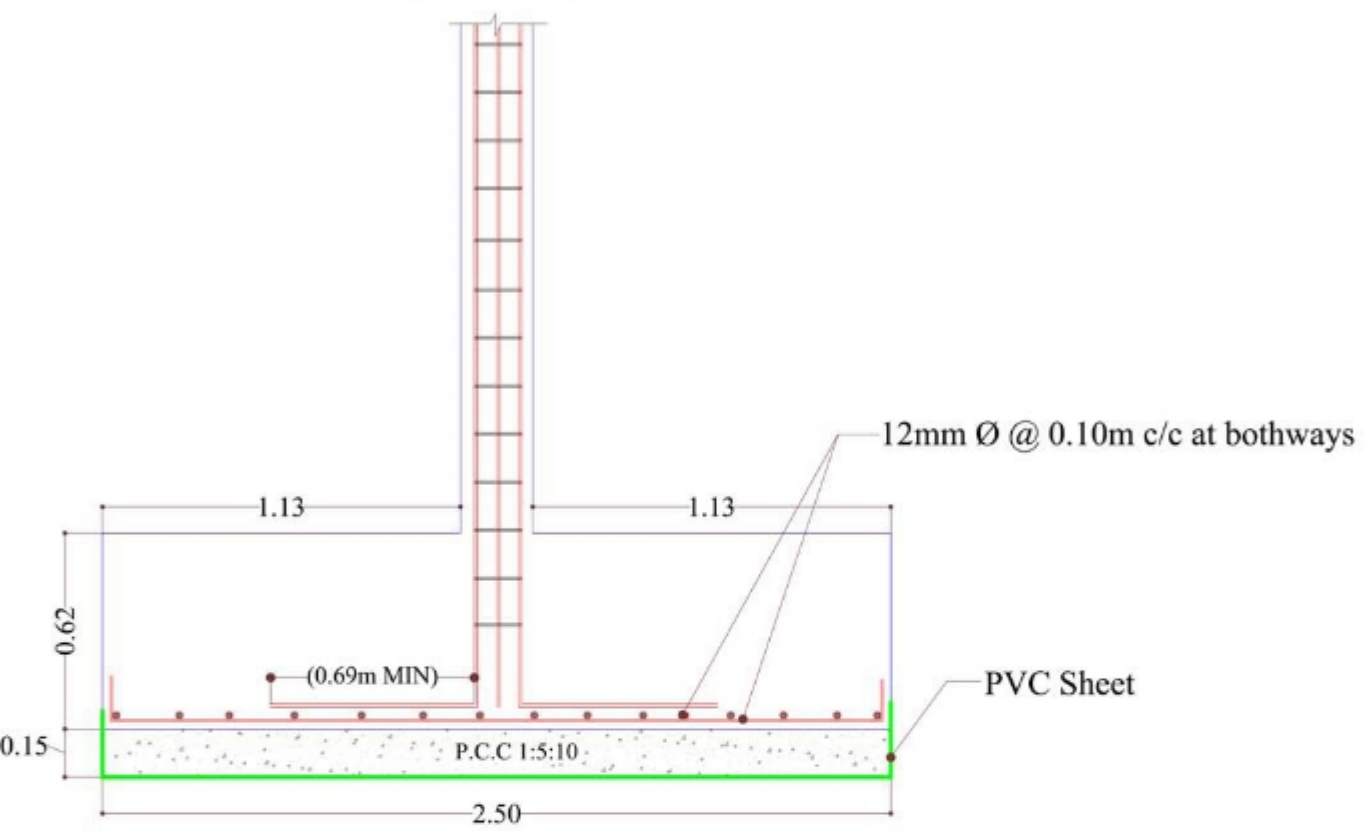

A. Shanavaz
A. SHANAVAZ M.E., M.I.E.,
 Chartered Civil Engg. M-150843-6
 Regd. Struct Engg. Coimbatore DTCP
 SE/GR-1/45/2025

DESIGN OF COLUMN

Data:

Total No. of floors		=	5
Total No. of Roof		=	6
Storey height		=	3 m
Breadth of column	b	=	230 mm
		=	0.23 m
Depth of column	D	=	600 mm
		=	0.60 m
	fck	=	20 N/mm ²

Total axial load

Dead load & live load from one floor		=	280 kN
Total axial load all floors		=	6 x 280
		=	1680 kN
Column dimension		=	230 x 600 mm
Self weight of column		=	0.23 x 0.60 x 6 x 20 x 3
		=	50 kN
Total load		=	(1680 + 50) x 1.5
	Pu	=	2595 kN


Area of Reinforcement

$$\begin{aligned}\frac{d'}{D} &= 0.08 \\ d' &= 50 \text{ mm} \\ \frac{Pu}{fck \times b \times D} &= \frac{2595 \times 10^3}{20 \times 230 \times 600} \\ &= 0.95 \\ \frac{Mu}{fck \times b \times D^2} &= \frac{1.5 \times 30.48 \times 10^6}{20 \times 230 \times 600^2} \\ &= 0.02\end{aligned}$$

Referring to chart in SP : 16 for values

$$\frac{Pu}{fck.b.D} = 0.95 \quad ; \quad \frac{Mu}{fck.b.D^2} = 0.02$$

$$\text{The value of } \frac{P}{fck} = 0.05$$

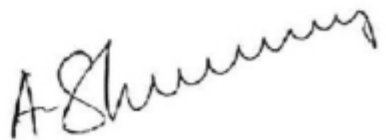
A. SHANAVAZ M.E., M.I.E.,
Chartered Civil Engg. M-150843-6
Regd. Struct Engg. Coimbatore DTCP
SE/GR-1/45/2025

$$\begin{aligned}
 P &= 0.05 \times 20 \\
 &= 1.0 \\
 A_s &= \frac{p \times b \times D}{100} \\
 &= \frac{1.6 \times 230 \times 600}{100} \\
 &= 2208 \text{ mm}^2
 \end{aligned}$$

Provide 12 – Y16 bars.

Design of Lateral Ties


$$\text{Dia of lateral ties} = \frac{1}{4} \times 16 = 4 \text{ mm}$$

Hence 8mm dia bar is adopted


Pitch is min. of the following – (as per IS: 456)

- Least lateral dimension = 300 mm
- 16 x dia of bar
- 300 mm

Hence provide Y8 @ 150mm c/c
Similarly other columns are calculated.

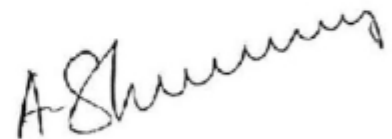

A. SHANAVAZ M.E., M.I.E.,
Chartered Civil Engg. M-150843-6
Regd. Struct Engg. Coimbatore DTCP
SE/GR-1/45/2025




COLUMN - C1
(0.23 x 0.60)


Main Reinforcements
 12 Nos 16mm Ø rts
 4 Legged Stirrups
 8mm @ 0.15m c/c



4 Legged Stirrups
 8mm @ 0.15m c/c

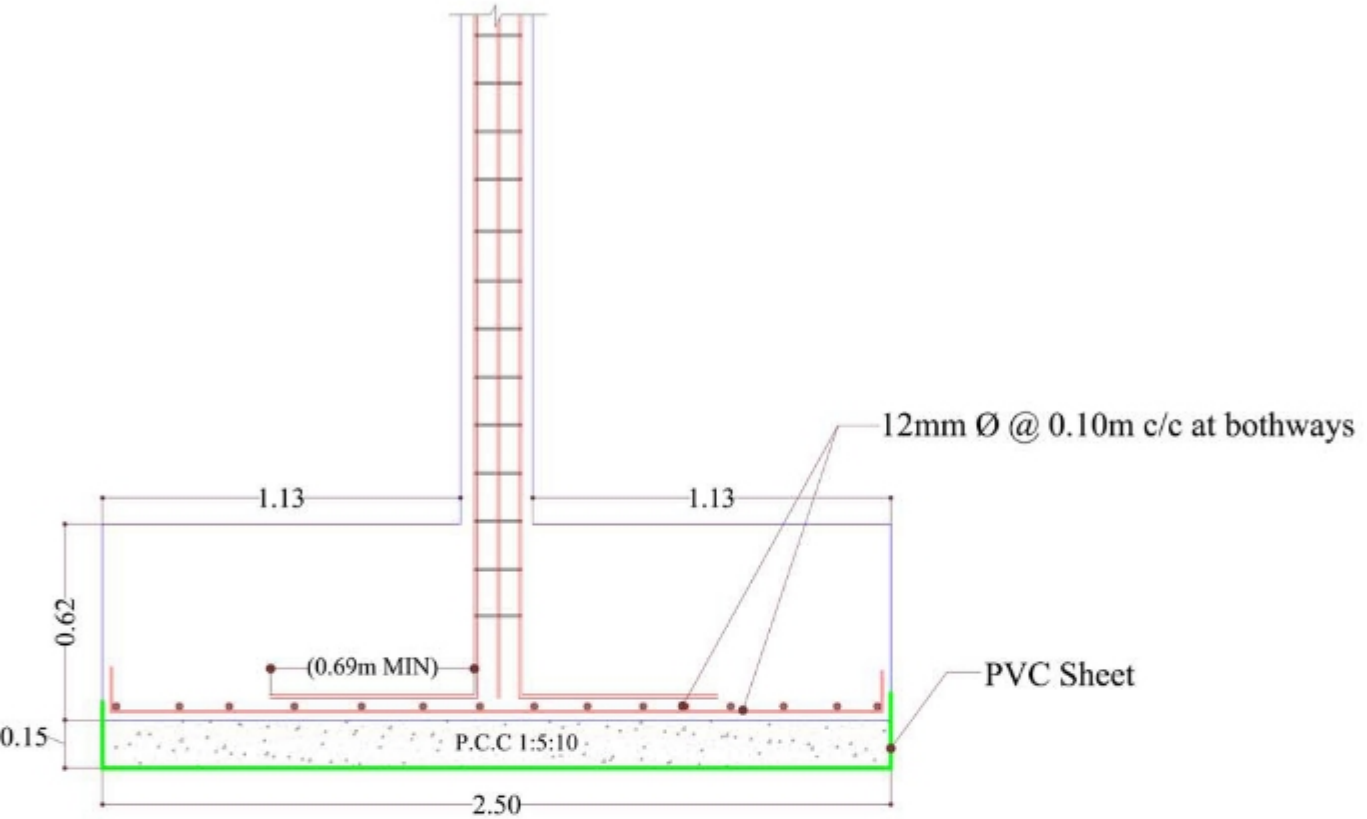

SECTION

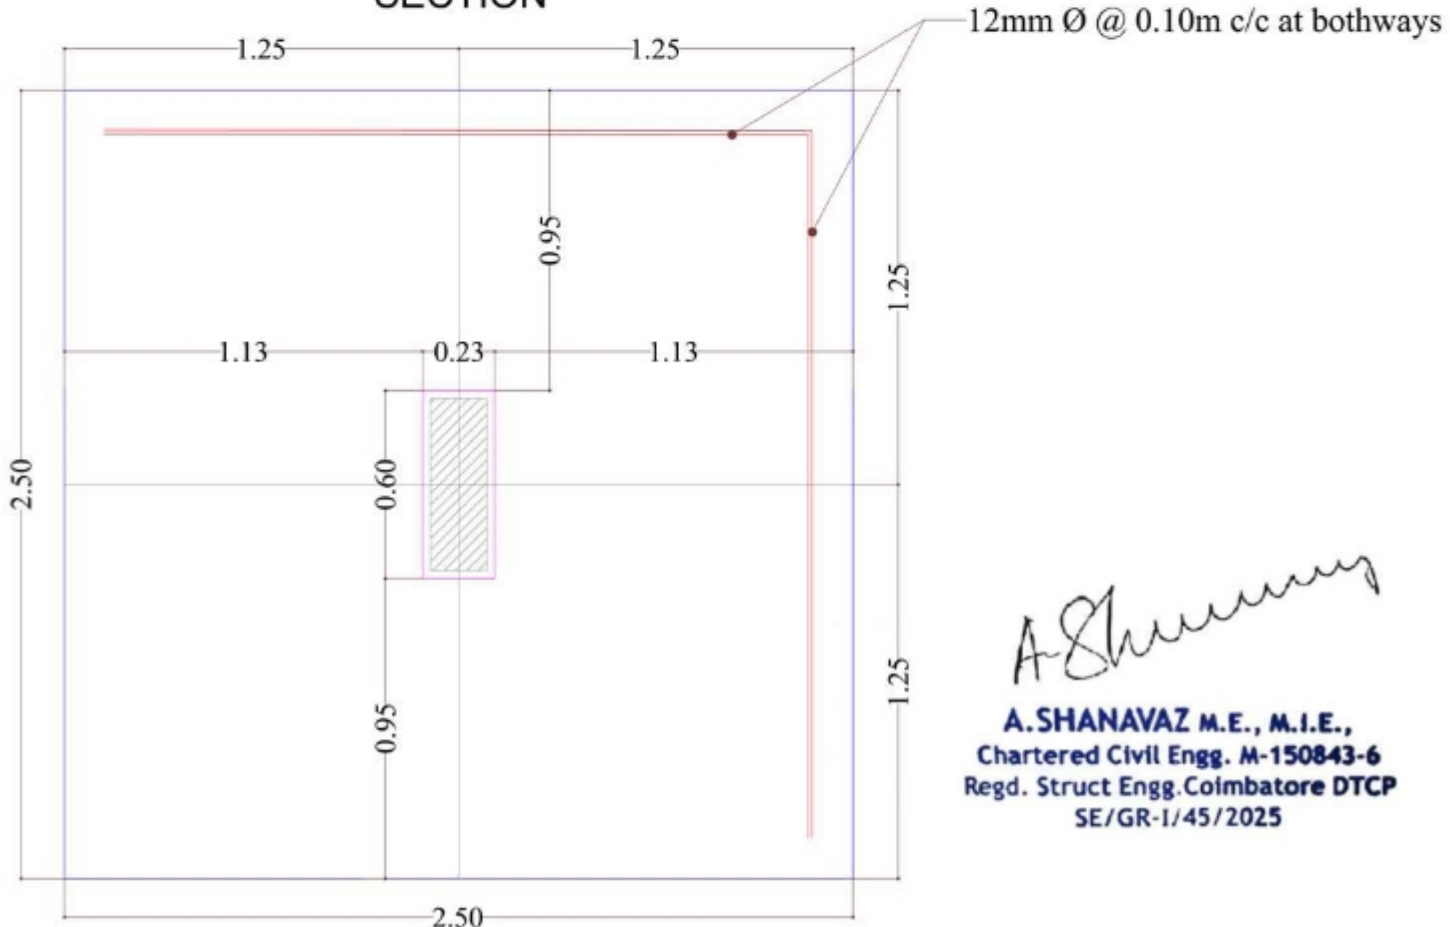

PLAN

A. Shanavaz
A. SHANAVAZ M.E., M.I.E.,
 Chartered Civil Engg. M-150843-6
 Regd. Struct Engg. Coimbatore DTCP
 SE/GR-1/45/2025

DESIGN OF FOUNDATION
Design of Isolated footing for Intermediate column

Data :

Column Size	L	=	230 mm
	B	=	600 mm
Size of footing	L	=	2.5 m
	B	=	2.5 m
Safe Bearing capacity of soil	SBC	=	450 kN/m ²
Depth of footing below GL		=	2 m
Density of soil	g	=	18 kN/m ³
Characteristic strength of concrete	f _{ck}	=	20 N/mm ²
Characteristic strength of Steel	f _y	=	500 N/mm ²
Depth of footing provided	D	=	1.2m
Cover	d'	=	50mm


1. Loading on footing

Axial load on column	=	2595 kN
Self weight of footing (10%)	=	131 kN
Total load on footing	=	2726 kN
Adopt size of footing	=	2.5 x 2.5 m
	=	6.25 m ²
Soil pressure	$\frac{P}{A}$	= $\frac{2726}{6.25}$
	=	436 kN/m ²
Gross safe bearing capacity	=	450 kN/m ²

Hence safe & sound

2. Moment Calculation

Face of the column	=	$\frac{2.5 - 0.60}{2}$
	=	0.95 m
Design pressure	=	436 kN/m ²
Moment	M	= $\left\{ \frac{436 \times (0.95)^2}{2} \right\}$
	=	196.75 kN.m
Factored moment	=	295.12 kN.m

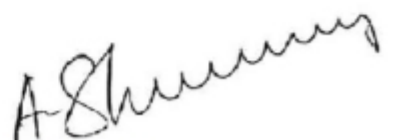
A. SHANAVAZ M.E., M.I.E.,
Chartered Civil Engg. M-150843-6
Regd. Struct Engg. Coimbatore DTCP
SE/GR-1/45/2025

3. Area of Reinforcement

Effective Depth	d	=	620 mm	(or)	0.62 m
Dia of bar provided	∅	=	20 mm		
Provided spacing		=	100mm		

$$\frac{M_u}{b \times d^2} = \frac{295.12 \times 10^6}{1000 \times 620 \times 620}$$
$$= 0.77$$

Percentage of tension reinforcement

$$p_t = \frac{f_{ck}}{2 \times f_y} \left\{ 1 - \left[\text{SQRT} \left[1 - \frac{4 \times (M_u / b \times d^2)}{0.87 \times f_{ck}} \right] \right] \right\} \times 100$$
$$= 0.51 \%$$

$$\text{Required, } A_{st} = \frac{0.51 \times 1000 \times 620}{100}$$
$$= 3162 \text{ mm}^2$$

Hence safe & sound

4. Check for One way shear

$$V_u = 1.5 \times 254 \times 3 \times 0.5 \times 0.30 \times 0.5 - 0.62$$
$$= 160 \text{ kN}$$

$$\text{Permissible shear stress} = \frac{160 \times 1000}{1000 \times 620}$$
$$= 0.26 \text{ N/mm}^2$$

$$\text{Allowable shear stress} = 0.49 \text{ N/mm}^2$$

Hence safe & sound


5. Check for punching shear

$$\text{Punching force } P_f = \left[254 \times 608 - ((0.23 + 0.62) \times (0.60 + 0.62)) \right] \times 1.5$$
$$= 2187 \text{ kN}$$

$$\text{Punching shear stress} = \frac{2,187 \times 1000}{620 \times 2 \times (230 + 6000 + (2 \times 620))}$$
$$= 0.85 \text{ N/mm}^2$$

$$\text{Allowable shear stress} = 1.25 \text{ N/mm}^2$$

Hence safe & sound

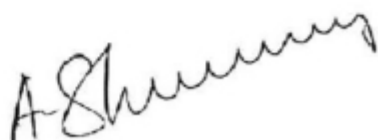
A. SHANAVAZ M.E., M.I.E.,
Chartered Civil Engg. M-150843-6
Regd. Struct Engg. Coimbatore DTCP
SE/GR-1/45/2025

3. Checking for footing


SBC
Soil pressure

$$\begin{aligned} &= 45 \text{ T/m}^2 \\ &= 25.4 \text{ T/m}^2 \end{aligned}$$

$$\frac{P}{A} \pm \frac{1.40 \times 6}{12}$$

$$\begin{aligned} &= 25.4 \pm 0.7 \\ &= 26.1 \\ &= 24.7 \text{ T/m}^2 < 40.00 \text{ T/m}^2 \end{aligned}$$

Hence safe & sound

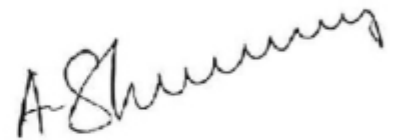

A. SHANAVAZ M.E., M.I.E.,
Chartered Civil Engg. M-150843-6
Regd. Struct Engg. Coimbatore DTCP
SE/GR-1/45/2025

EARTH QUAKE ANALYSIS

1. Calculation of horizontal seismic Coefficient

As per IS 1893 – 2002

$$A_h = \frac{z \times 1 \times S_a}{2 \times R \times g}$$

$$\left. \begin{array}{lll} \text{Zone factor} & Z & = 0.16 \\ \text{Importance factor} & I & = 1 \\ \text{Response reduction factor,} & R & = 5 \end{array} \right\} \text{ (As per table 7)}$$

$$\frac{S_a}{g} = 2.5$$

$$\begin{aligned} \text{Natural period,} \quad T_a &= 0.075 h^{3/4} \\ \text{(Clause 7.6) } h &= \text{height of the building} \\ &= 0.075 \times 13.1^{0.75} \\ &= 0.52 \text{ sec} \end{aligned}$$

$$\begin{aligned} A_h &= \frac{0.16 \times 1 \times 2.5}{2 \times 5} \\ &= 0.04 \end{aligned}$$

2. Calculation of Base shear & seismic forces


$$\begin{aligned} \text{Base shear} \quad V &= A_h \sum W_i \\ &= 0.040 \times 1316 \\ &= 52.64 \text{ kN} \end{aligned}$$

$$\begin{aligned} \text{Total no of columns} &= 21 \\ \text{Shear per column} &= \frac{25.64}{21} \end{aligned}$$

$$\begin{aligned} \text{Seismic moment per column} &= \frac{1.22 \times 3}{4} \\ &= 0.92 \text{ T-m} \end{aligned}$$

$$\text{Column provided} = 230 \times 600 \text{ mm} \quad \text{with 12 -Y16}$$

Hence safe & sound

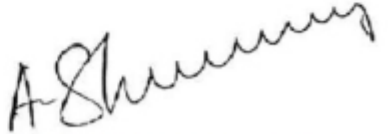
A. SHANAVAZ M.E., M.I.E.,
Chartered Civil Engg. M-150843-6
Regd. Struct Engg. Coimbatore DTCP
SE/GR-I/45/2025